



Since 1957


**H-M Company**  
**LINT INTERCEPTOR**  
www.draintroughs.com

2305 Gilbert Avenue  
Cincinnati, Ohio 45206  
Telephone: (513) 281-3832  
Telephone: (800) 365-1900  
Fax: (513) 281-0572

Installation/Operation Instructions

On Or Above Ground Installation

### Side View

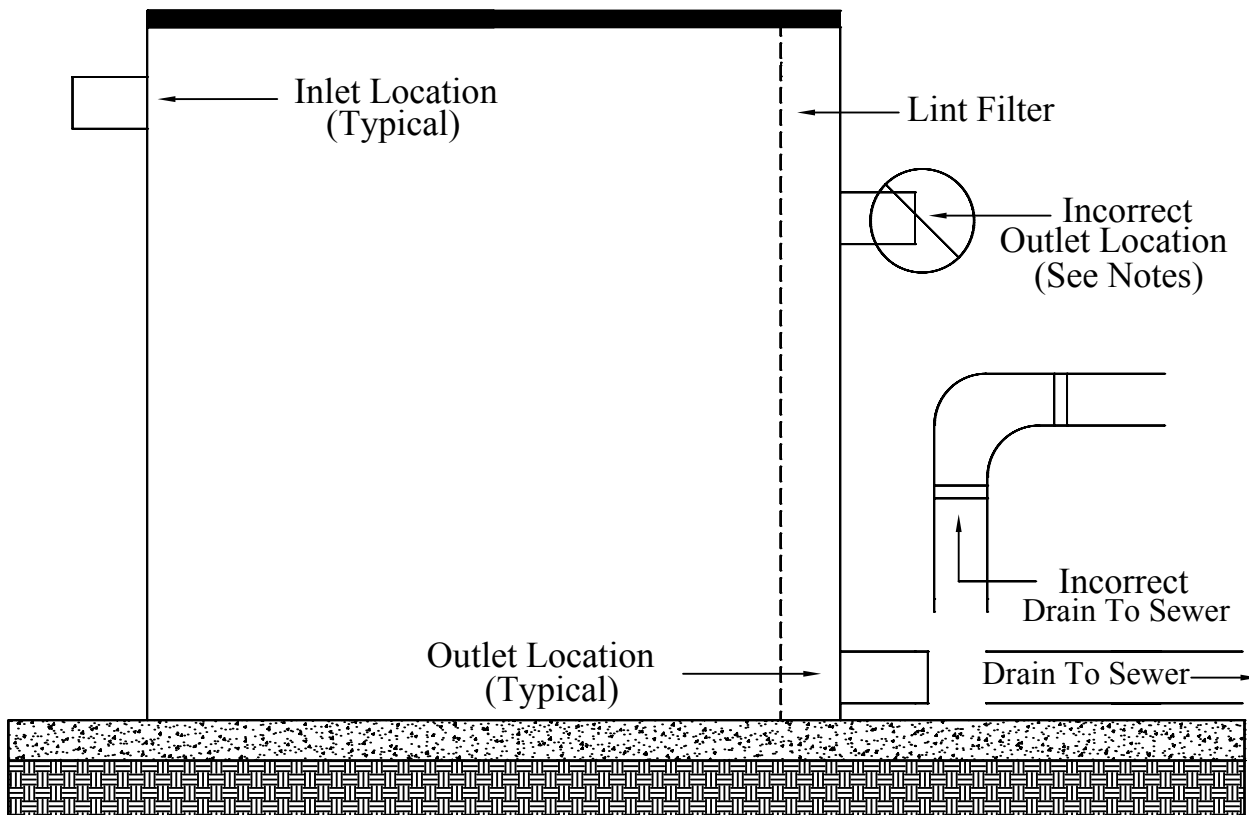

Outlet Location Must Be Located Within 6" Of The Bottom Of The Unit. (See Drawing Above)

If Unit Is Installed On A Base The Top Of The Base Must Be A Solid Level Surface That Is Supported On all Four Sides And In The Middle. Base Construction (If Required), And It's Structural Integrity Is The Responsibility Of Others.

Use Hole Saw To Cut Hole For Fitting Kits Provided

Place Gasket On Inside And Outside Of Unit

Screw Fitting Kit Together Compressing Gaskets To The Unit. No Adhesive Required

Glue PVC Pipes Into Fitting Kits

Lint Filter Must Be Cleaned On A Weekly Basis

Lid(s) Must Be Screwed To The Unit At All Times Except When Cleaning The Filter